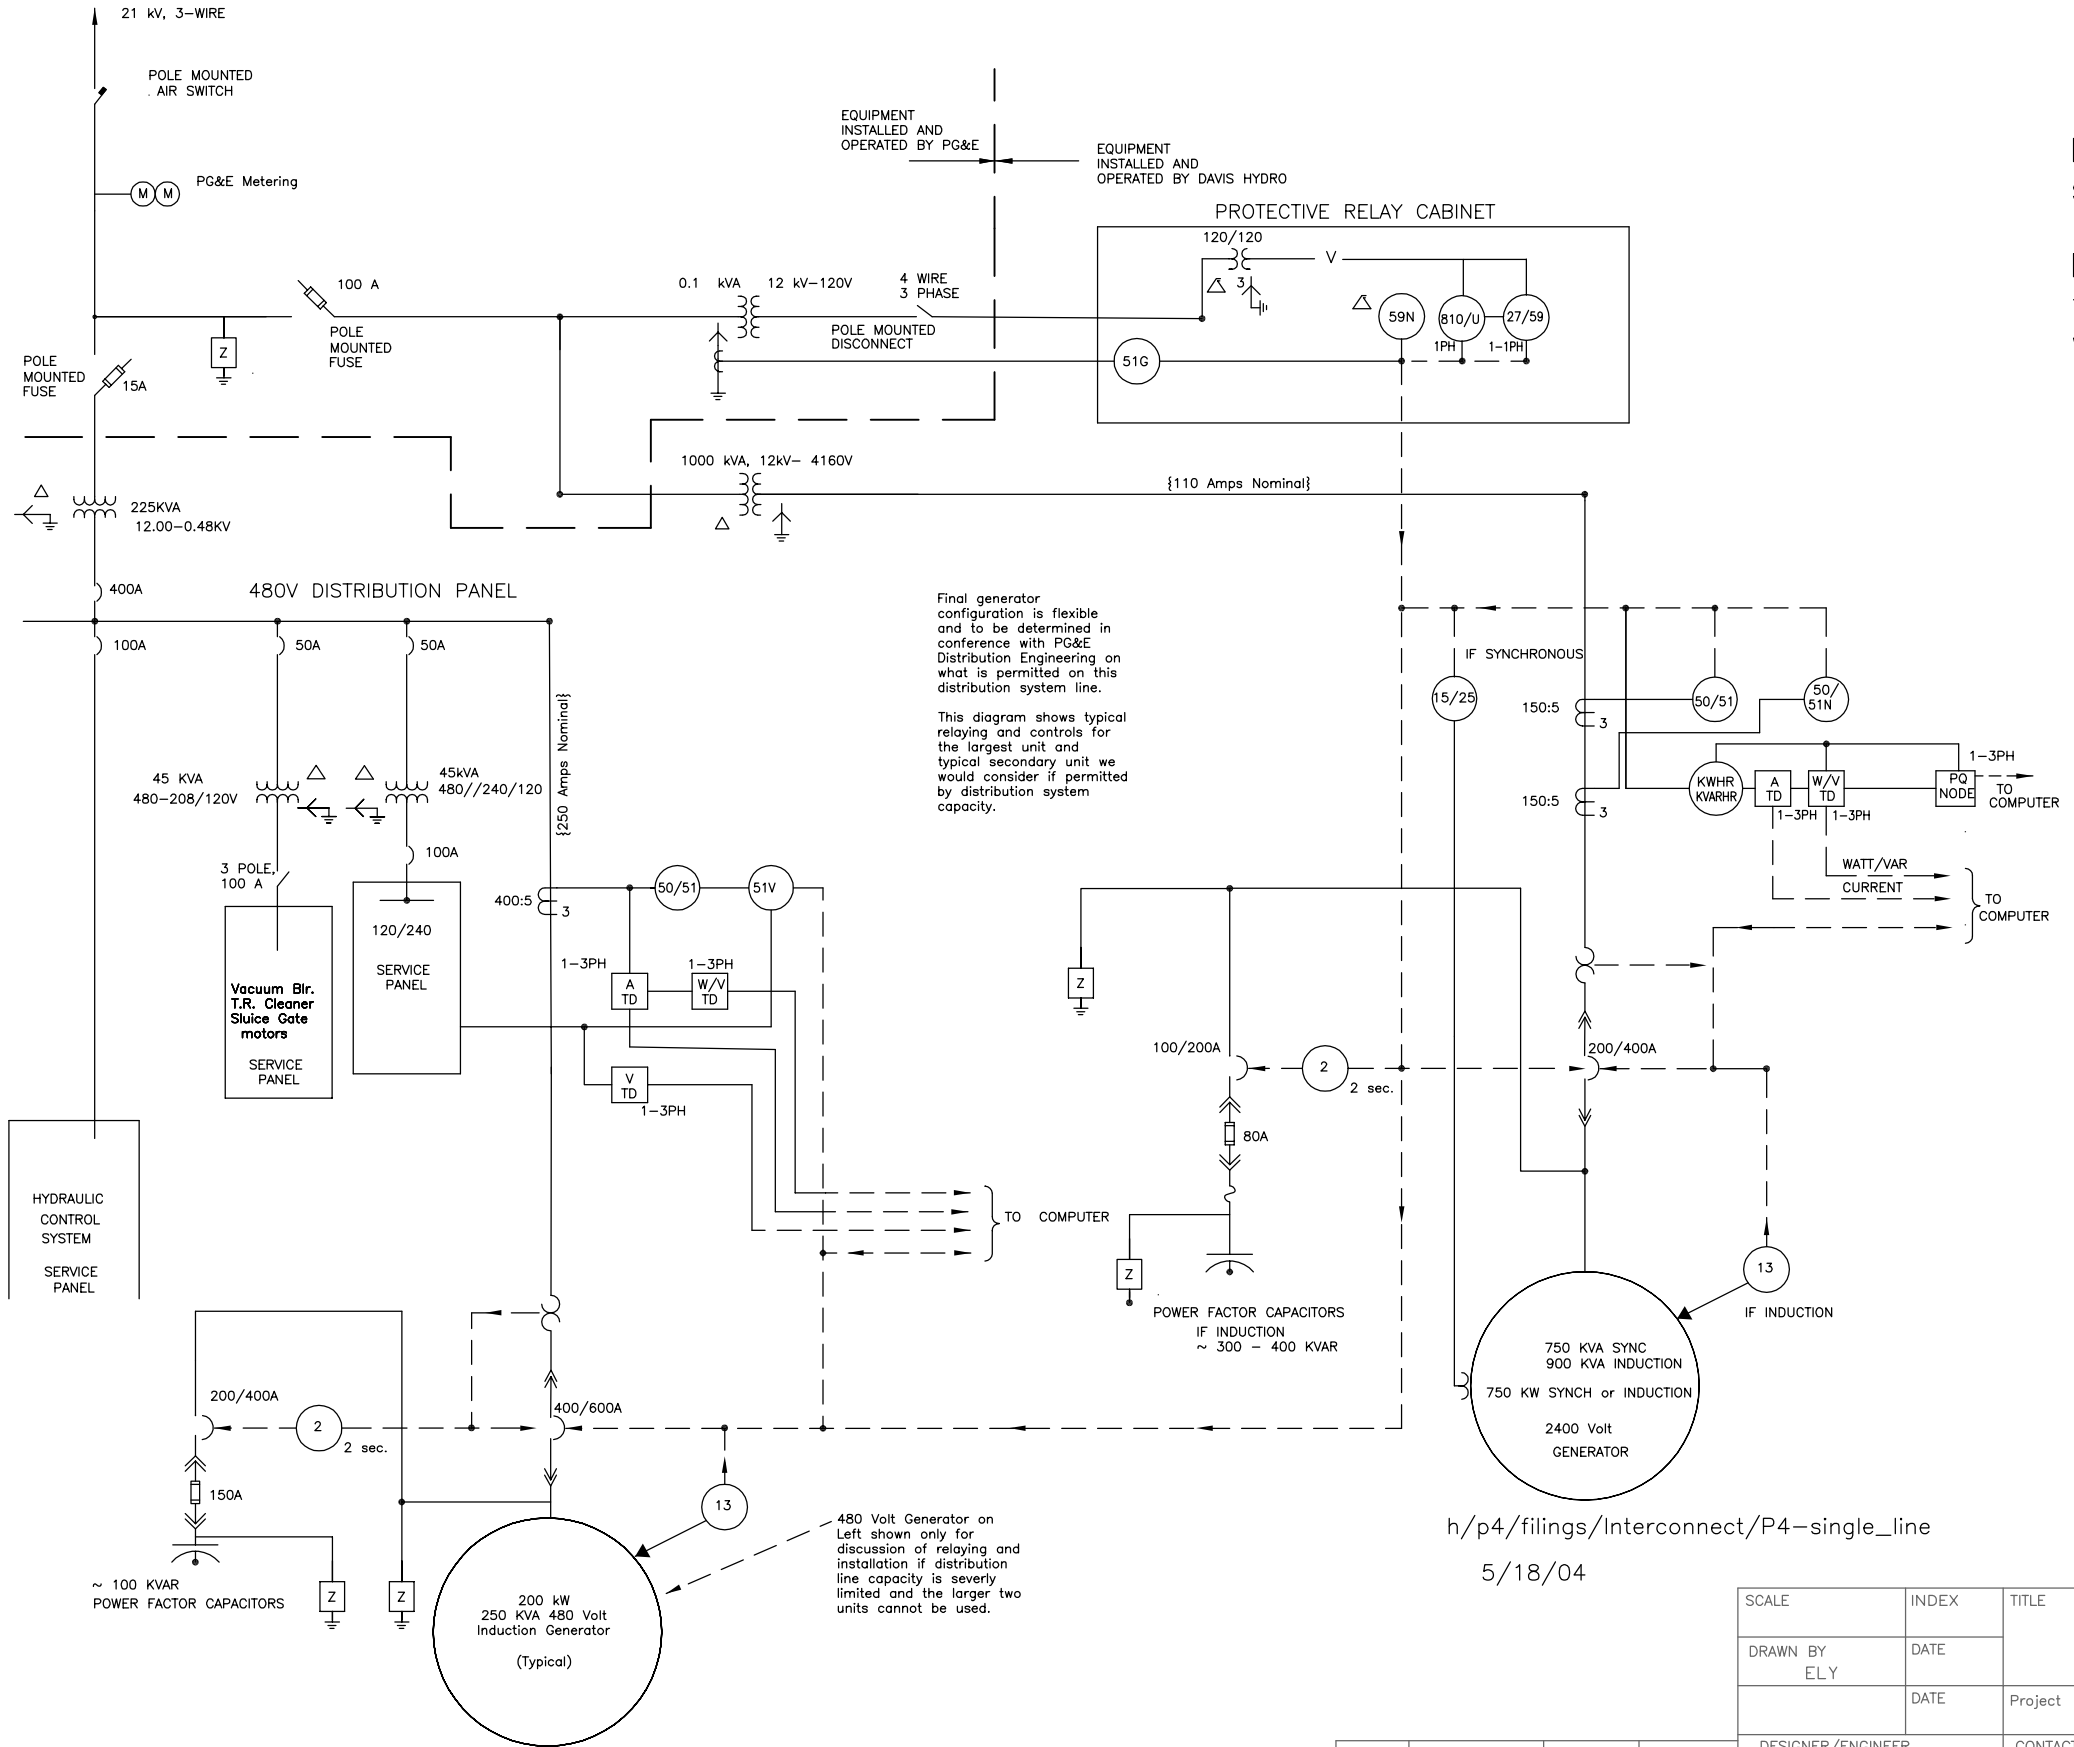

Notes

Data logging, transfer trip, and not shown.

Multi secondary transformer prefered to shown arrangement. One secondary with metering accuracy.

h/p4/filings/Interconnect/P4–single_line

5/18/04

NO	DATE	REVISION	Drawn BY	Revision Sent	Sent to		Media/
0			J. Vard. PG&E	5/18/04			E–mail

SCALE	INDEX	TITLE	Single Line Diagram
DRAWN BY ELY	DATE		
	DATE	Project	Pit 4 Dam Retrofit Project
DESIGNER/ENGINEER Staff	CONTACT 530 753-8864	File h/p4/filings/Interconnect/P4–single_line	
27264 Meadowbrook Drive DAVIS CALIFORNIA 95616		DWG NO P4–E–1	REVISION 0